

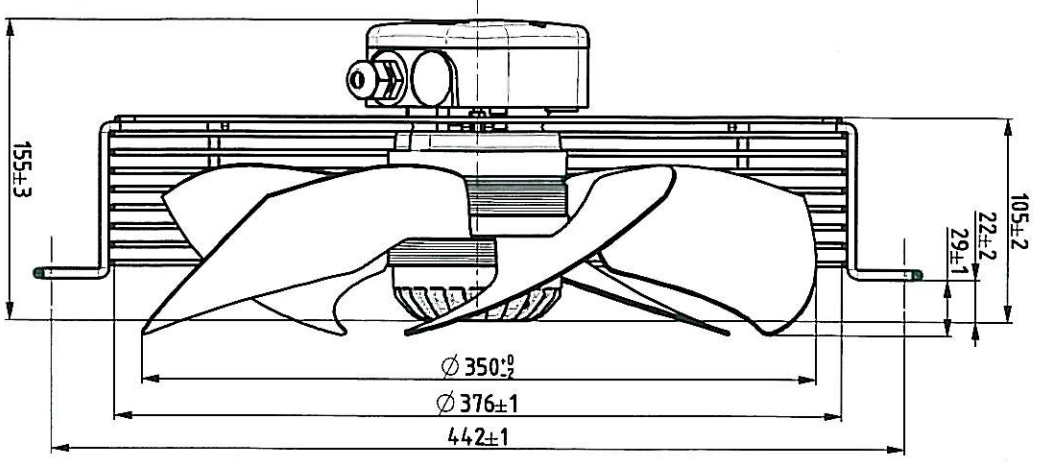
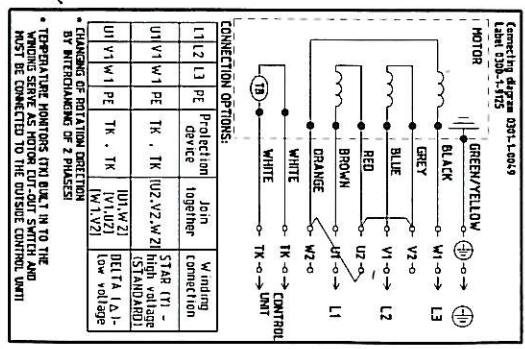
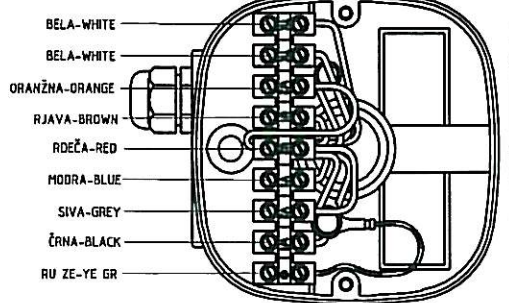


Vsak prenos tretjim osebam in uporaba v nedogovorjena namena ni dovoljen.
 This document must not be copied without our written permission and/or transferred to a third party for any unauthorized purpose.

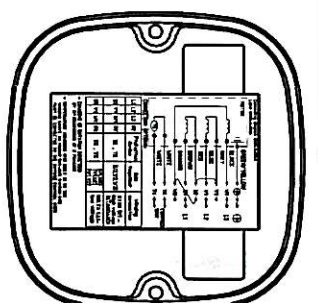

SUCKING
 AIRFLOW DIRECTION
 SMER ZRAKA

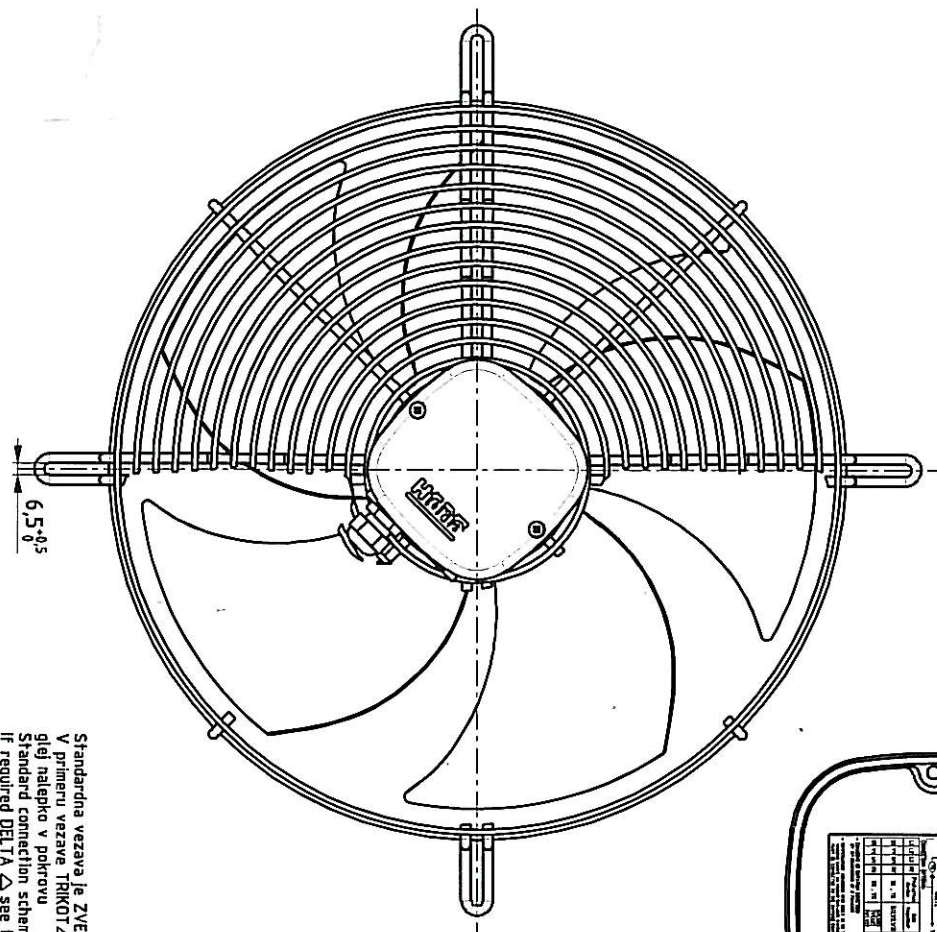

Standardna vezava je ZVEZDA Y
 V primeru vezave TRIKOT Δ
 oglej nalepko v pokrovu
 Standard connection scheme is STAR Y
 If required DELTA Δ see the
 connection diagram in the cover

Navodila za kontrolo 0301-1-4607
 Checking instruction 0301-1-4607

HTPTA
 MADE IN SLOVENIA
 CE DATE
 809R-3530HA-4T-4203
 3~Y, 50/60/230V 50Hz 0.30/0.55A 195W 1300RPM
 3~Y, 50/60/230V 60Hz 0.30/0.55A 170W 1460RPM
 THPROT: IP24, INS:CLF
 ROT:

ST.	SESTAVE	QTY	UNIT	REMARKS
1	SESTAVE			
2	SESTAVE			
3	SESTAVE			
4	SESTAVE			
5	SESTAVE			
6	SESTAVE			
7	SESTAVE			
8	SESTAVE			
9	SESTAVE			
10	SESTAVE			
11	SESTAVE			
12	SESTAVE			

NORDICOLD
 VENTILATOR
 R09R-3530HA-4T-4203
 0309-4-1023
 0301-1-4607