

# RDI Series Rupture Disk Indicator

# Over pressure or discharge indication for rupture disk and safety relief valve applications

The Rupture Disk Indicator RDI is a simple and effective means of indicating when the process media ruptures a disk or the valve has discharged.

#### Operation

The RDI installs onto the vent side of a rupture disk assembly or onto the discharge side of a relief valve. Upon rupture of the disk or discharge of the relief valve, the RDI alarm circuit is opened by the flowing media.

#### **Features**

- One time use, cost effective, stand alone burst indication
- Sizes 1" thru 24" (25 mm thru 600 mm)
- Compatible with Metal or Graphite Rupture Disks or for stand alone use (relief valve applications)
- Resistant to most chemicals
- Minimizes downtime due to immediate burst indication
- Supplied ready for installation
- Installs easily into existing pipe systems
- Furnished with attached 6'6" (2m) PTFE sheathed connection cable
- No routine maintenance required
- Installs on outlet side of graphite rupture disk or metal rupture disk holder isolating the RDI from the process media
- The RDI burst indicator has been ATEC system certified to ATEX Directive 94/9/EC and standard EN50039

#### **Materials**

**Gaskets** – Compressed fiber **Membrane** – Kapton **Conductive material** – Silver

**Leadwire** – 6'6" (2m), 24 AWG, 2 conductor PTFE sheathed connection cable


RDI Operating Limits		
Max. Voltage	24 VDC	
Max. Current	150 mA	
Temp. Range	-40°F to 400°F (-40°C to 204°C)	

## **Specifications**

RDI Size	Minimum Burst Pressure psi (barg) @ 72°F (22°C)	Nominal Indicator Thickness
1" (25 mm) - 2" (50 mm)	5 (0.34)	3/16" (21mm)
3" (75 mm)	3 (0.21)	
4" (100 mm)	2 (0.21)	
6" - 24" (150 mm - 600 mm)	1 (0.07)	



#### **Typical Installation**

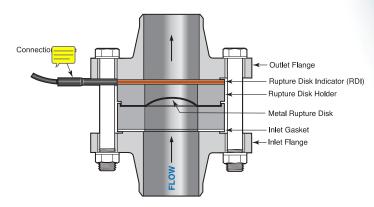


Note: RDI is considered a simple device, therefore ATEX approval is not required. Installation must be in accordance with ANSI/ISA RP12.6 and the NEC (ANSI/INFPA 70)

#### **Ordering Information**

When ordering RDI, specify: flange size, flange series, relieving pressure of pressure relief device, and coincident temperature. Contact ZOOK for stocked sizes ready for immediate shipment.

## **RDI Series Specifications**

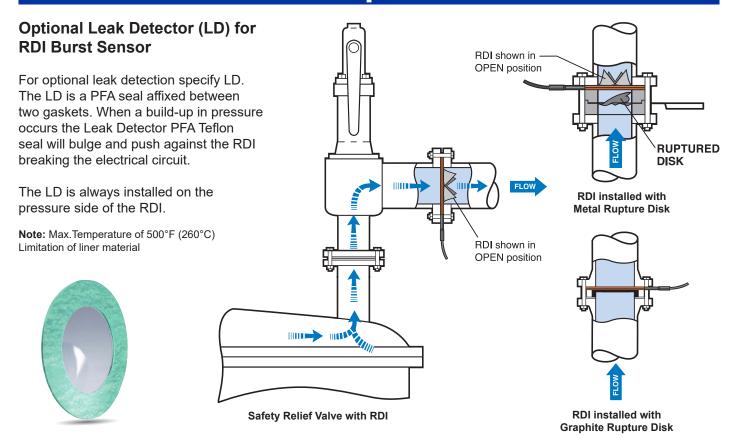


#### **Monitor**

The RDI Rupture Disk Indicator works with ZOOK ZAM Plus Alarm Monitor or any other monitoring system. Contact ZOOK for additional information. The monitor wired to the RDI will be activated providing immediate local or remote warning of a ruptured disk. The ZAM Plus monitor allows output to control pumps, valves, and other equipment which may be activated to control or shutdown a process.

#### CAUTION

The RDI is an electrical device suitable for use in hazardous locations (Class I, II, and III, Division 1 and 2, Group A thru G) provided that it is used with an approved intrinsically safe electrical alarm monitor.

For services involving highly electrically conductive fluids, contact ZOOK for this type of application.

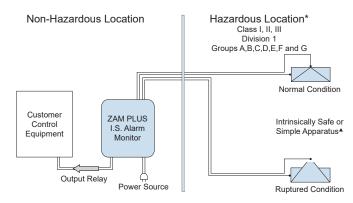

- \*Contact ZOOK for information about mounting
- the ZAM Plus Alarm Monitor in hazardous locations
- ▲Hazardous location equipment must be

NEC compliant or simple apparatus



KAPTON - Registered TM DuPont

RDI 062021

## Visit us at www.zookdisk.com

#### **SERVING AMERICA, CENTRAL** & SOUTH AMERICA

16809 Park Circle Drive Chagrin Falls, Ohio 44022 United States

Toll Free: +1 800 543 1043 Phone: +1 440 543 1010 Fax: +1 440 543 4930 E-mail: sales@zookdisk.com

#### SERVING EUROPE **MIDDLE EAST & AFRICA**

Navigation House, Bridge St. Killamarsh, Sheffield, S21 1AL United Kingdom

Phone: +44 (0) 1909 560999 Fax: +44 (0) 1909 560860 E-mail: sales.europe@zookdisk.com

#### **SERVING** CANADA

4400 South Service Road Burlington, Ontario, L7L 5R8 Canada

Toll Free: +1 800 370 6057 Phone: +1 905 681 2885 Fax: +1 905 681 8838 E-mail: sales.canada@zookdisk.com

#### **SERVING ASIA PACIFIC**

Unit No. 23A-05, Menara Landmark No.12, Jalan Ngee Heng 80000 Johor Bahru, Johor, Malavsia

Phone: +60 (7) 2910099 Fax: +60 (7) 2910096 E-mail: sales.asia@zookdisk.com

